


**SIDEWALK REPLACEMENT
VILLAGE OF ONEIDA CASTLE
50% REIMBURSEMENT ***

- A. Must first request village permission for sidewalk replacement
- B. Must be a public sidewalk. Not a sidewalk leading to private property
- C. Must have two quotes and village to approve contractor.
- D. Homeowner will pay sidewalk contractor and bring paid receipt to the village for reimbursement.
- E. Homeowner must follow sidewalk specifications that are:
 - 1. Must conform in size with existing sidewalks
 - 2. Must have at least four inches (4") of Class B concrete, with twenty-eight (28) day compressive strength of three thousand seven hundred fifty (3750) PSI (minimum)
 - 3. There must be at least six inches (6") of compacted gravel that is free from organic gravel on a stable compacted grade.
 - 4. Must have transverse expansion joints one half inch ($\frac{1}{2}$ ") wide provided at twenty foot (20') maximum intervals. Expansion joints shall be filled with material type as per latest NYCDOT specifications (closed cell polyethylene, pre-molded Bituminous, or approved equal) score
 - 5. Sidewalks over driveways shall be the same requirements except the concrete shall be a minimum of seven inches (7")


* NOTE: This policy is reviewed annually and funding for the 50% Reimbursement program might not be available every year.

1 STANDARD CONCRETE SIDEWALK
NTS

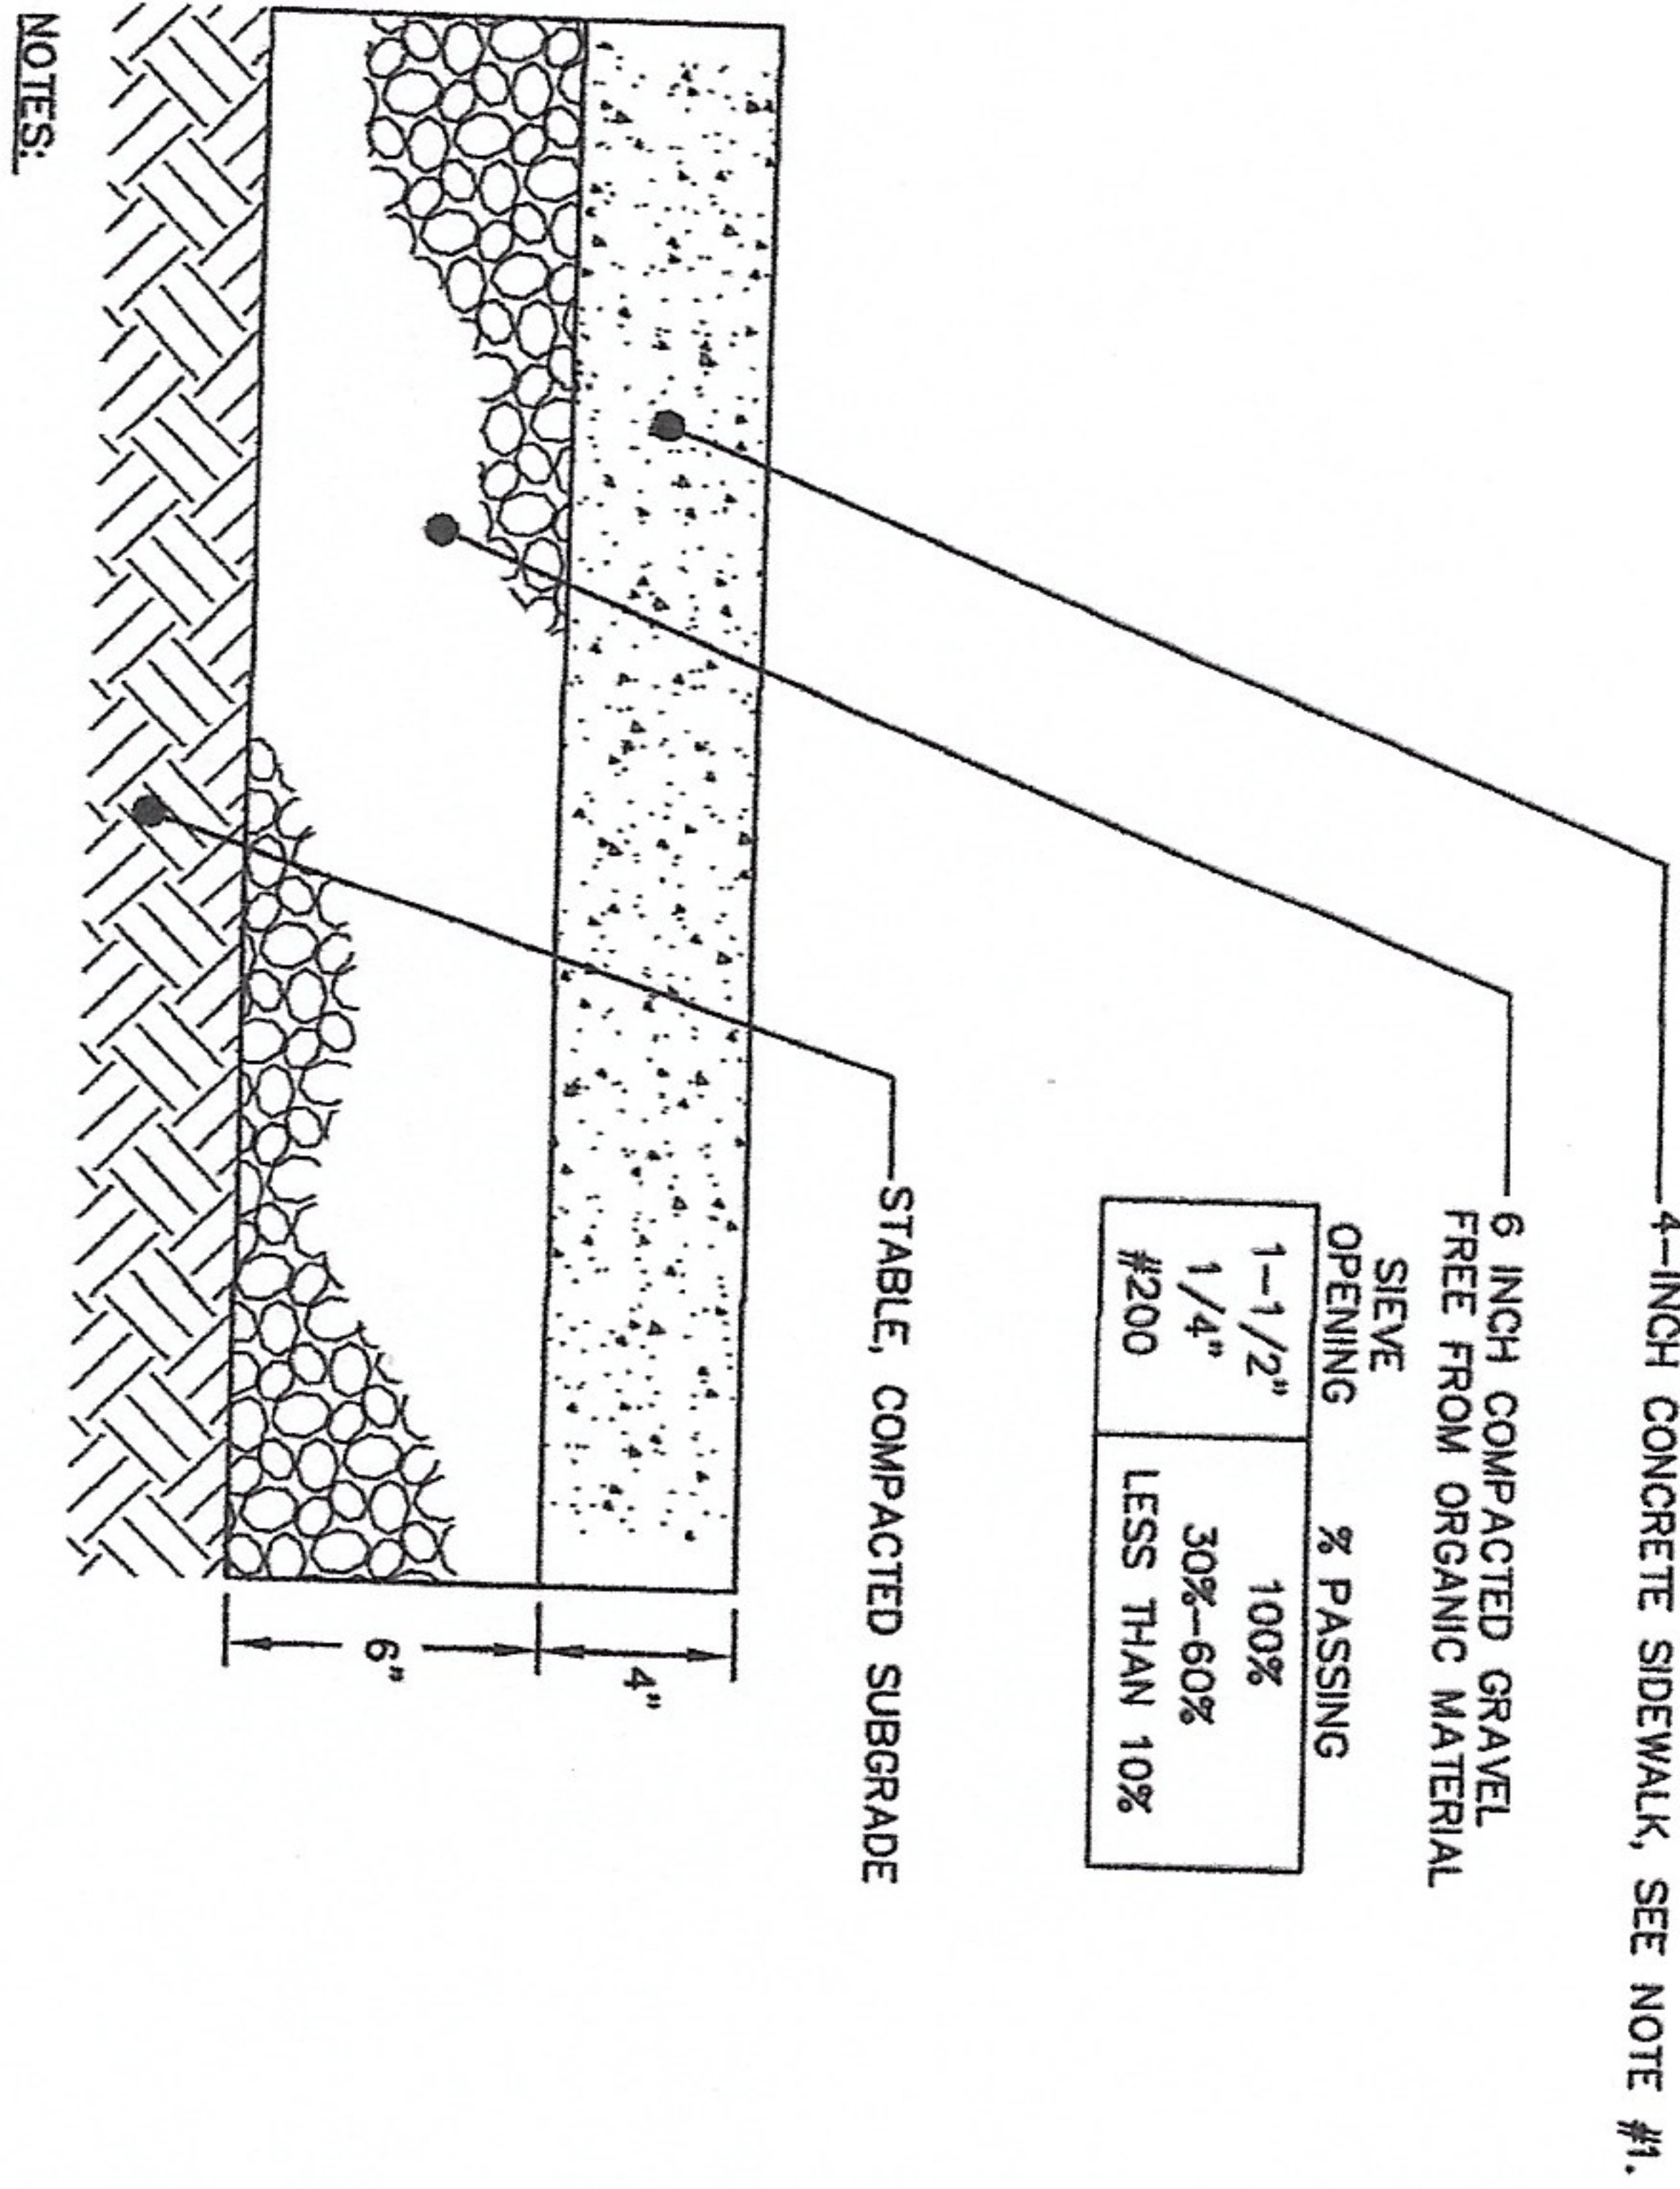

- NOTES:
1. CONCRETE SHALL BE CLASS B, WITH A 28-DAY COMPRESSIVE STRENGTH OF 3,750 PSI (MIN.)
 2. TRANSVERSE EXPANSION JOINTS (1/2-INCH WIDE) SHALL BE PROVIDED AT 20-FOOT MAXIMUM INTERVALS. EXPANSION JOINTS SHALL BE FILLED WITH MATERIAL TYPE AS PER LATEST NYCDOT SPECIFICATION (CLOSED CELL POLYETHYLENE, PREMOULDED BITUMINOUS, OR APPROVED EQUAL) SCORE LINES SHALL BE EVERY 5-FEET O.C.

2 CONCRETE SIDEWALK AT DRIVEWAYS
NTS

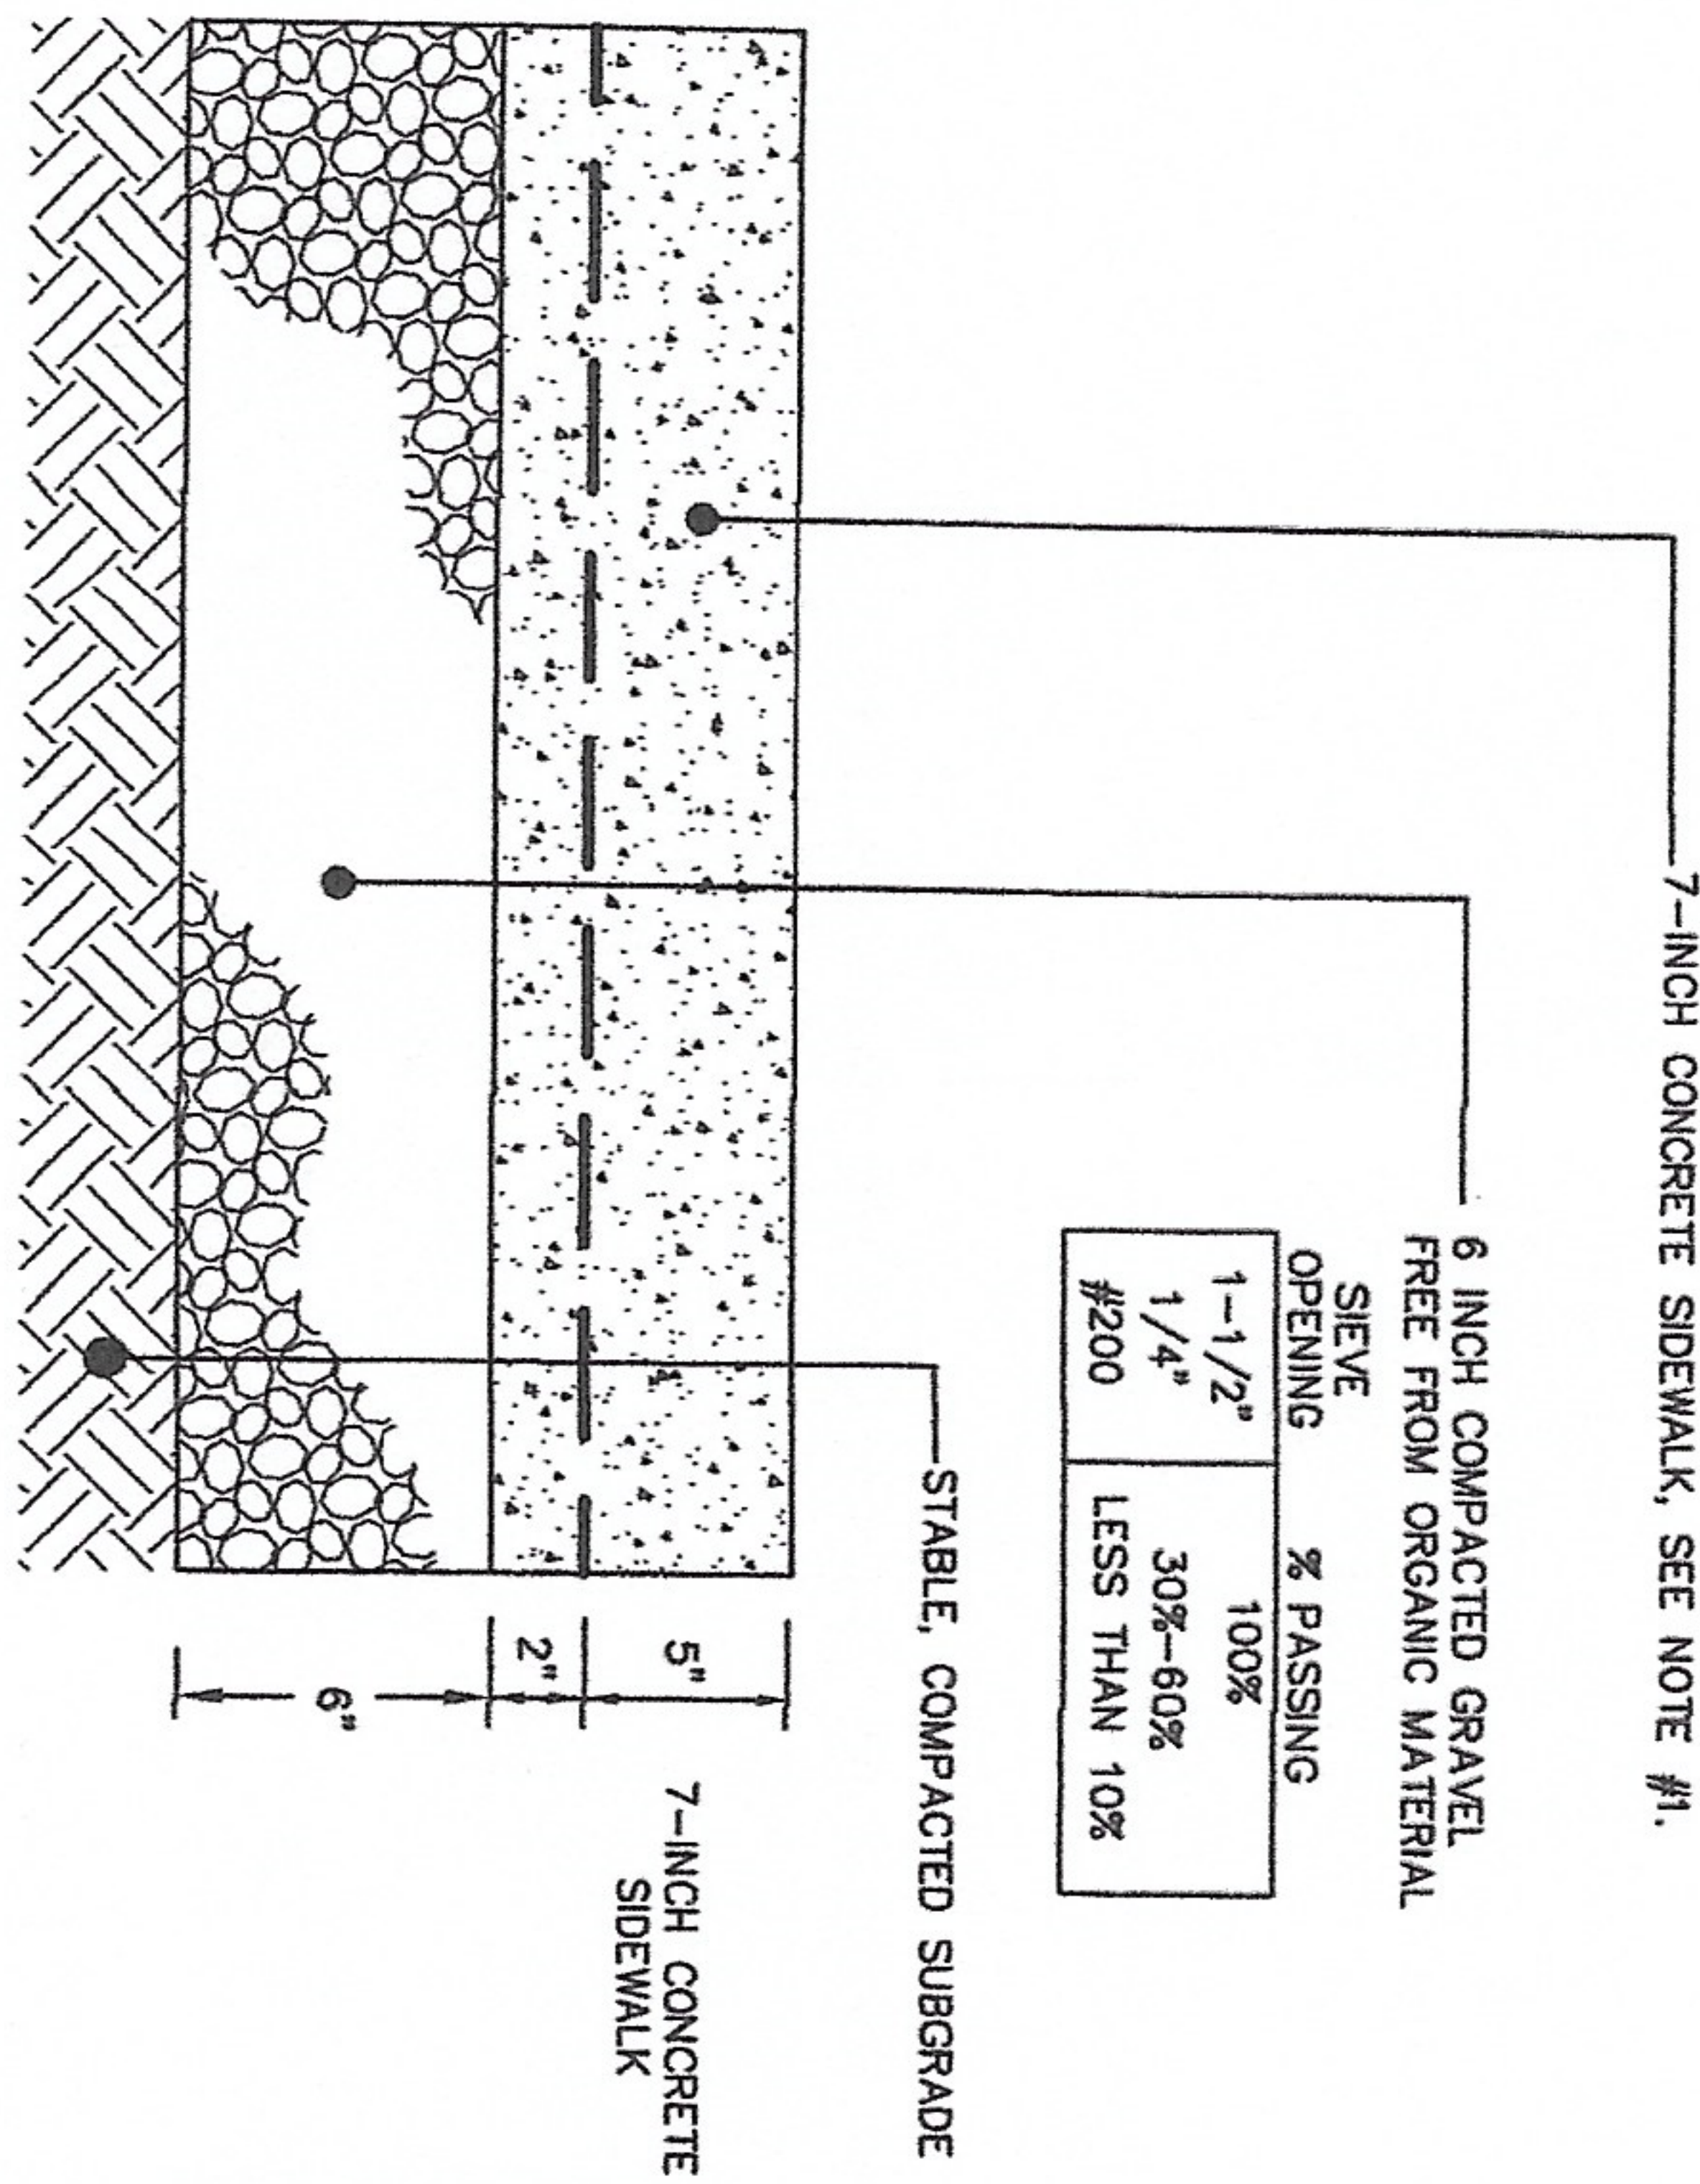

- NOTES:
1. CONCRETE SHALL BE CLASS B WITH A 28-DAY COMPRESSIVE STRENGTH OF 3,750 PSI (MIN.)

DRAWING TITLE:
CONCRETE SIDEWALK SECTIONS

DATE: 6/3/13 SCALE: NTS DRAWING #: